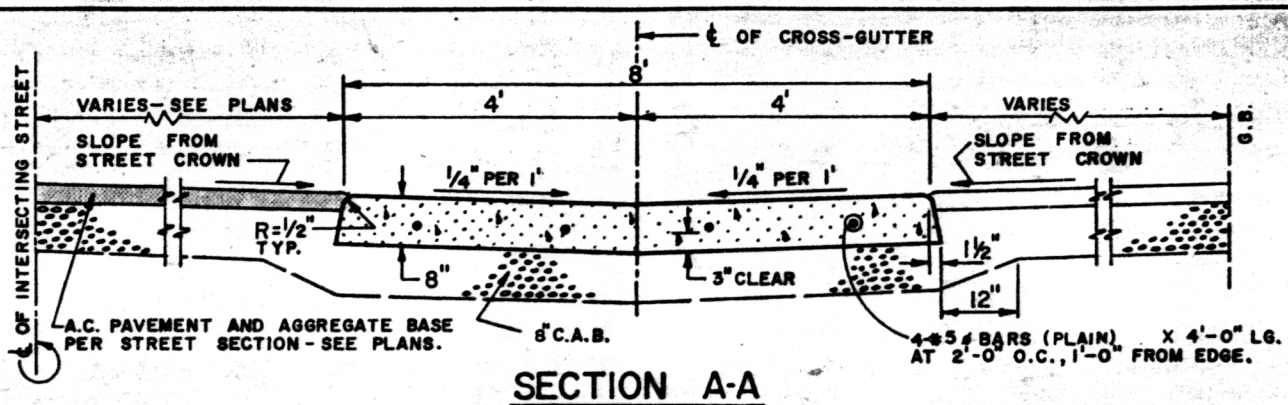

SECTION A-A

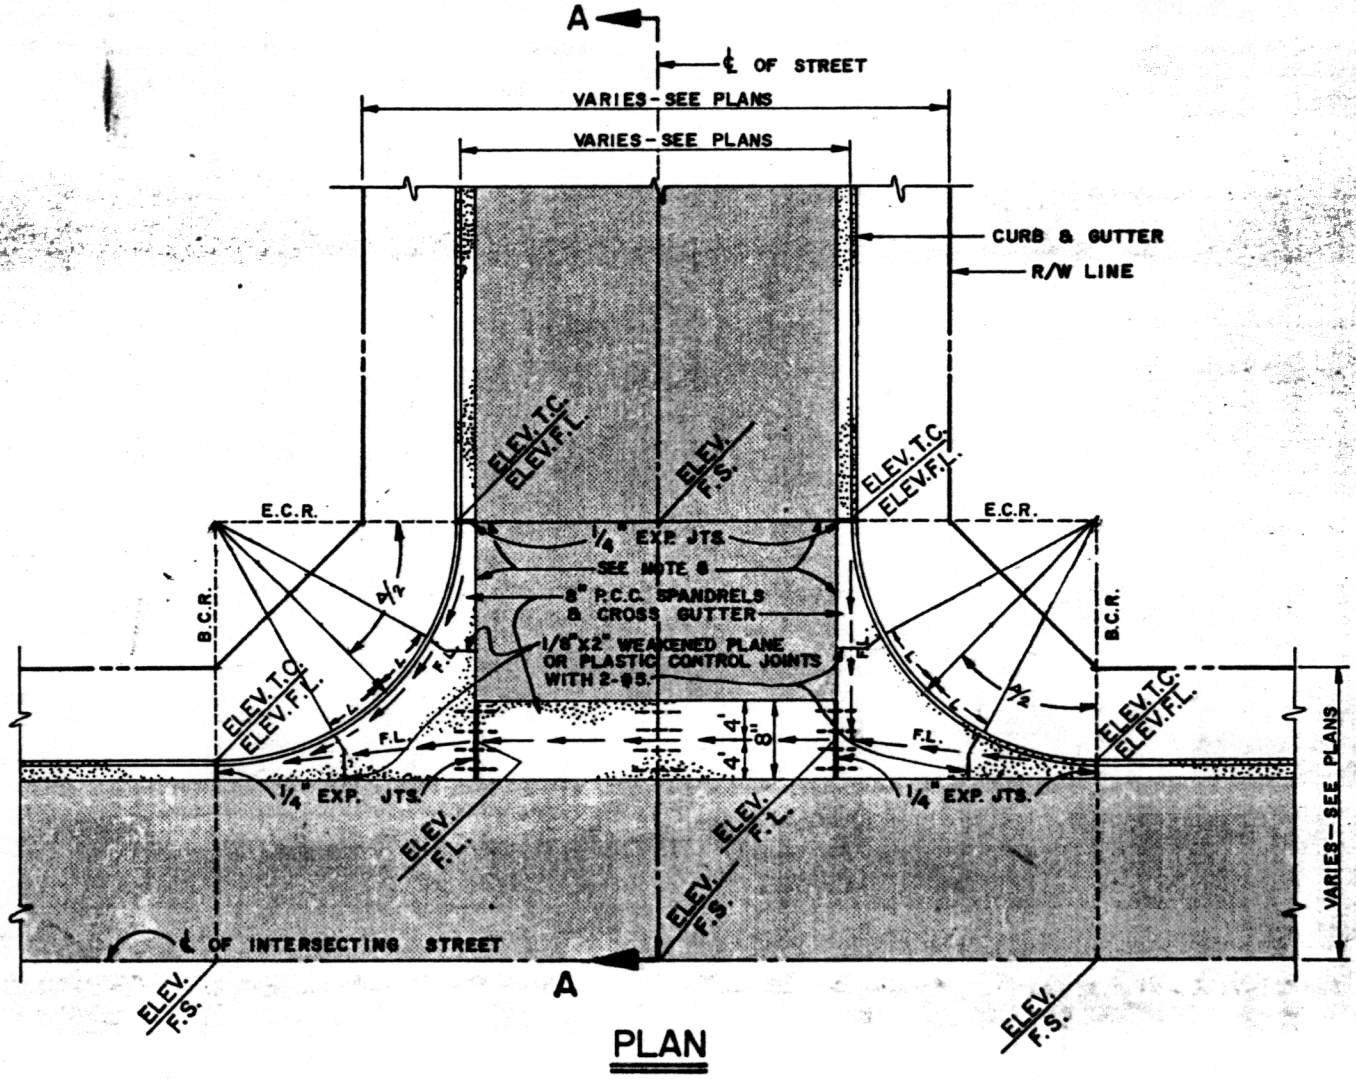

PLAN

NOTES:

1. SMOOTH TROWEL 8" WIDE FLOW LINE IN CROSS-GUTTER AND SPANDRELS.
2. AGGREGATE BASE THICKNESS FOR SPANDRELS SHALL BE THE SAME AS FOR CROSS-GUTTER.
3. POUR CURB MONOLITHICALLY WITH SPANDREL.
4. FOR JOINT DETAILS, SEE STD. DWG. NO. 314 AND 414.
5. CONCRETE SHALL BE S60 C 3250 PER CURRENT EDITION OF STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, SEC 201-1.1.2.
6. ALL ELEVATIONS SHALL BE PER PLAN.
7. DISTANCE L FROM MIDDLE ORDINATE OF CURB RETURN TO JOINT SHALL BE 7' FOR 8" C.F. OR 6' FOR 6" C.F..
8. ANY CROSS-GUTTER TO BE CONSTRUCTED ON LESS THAN 0.20 % SHALL HAVE DRAINAGE STRUCTURES CONSTRUCTED TO MITIGATE THE ADVERSE EFFECTS OF NUISANCE WATER AND FULL CONCRETE APRON WITH EXPANSION JOINTS ALONG ℄ AND ALONG EDGE OF GUTTERS.

CITY OF COSTA MESA CALIFORNIA PUBLIC SERVICES DEPARTMENT	TYPICAL CROSS-GUTTER APPROVED B.D. Mattern DATE 12/13/85 BRUCE D. MATTERN R.C.E. 19388	DRAWN M.K.S. SCALE NONE STD. DWG. NO. 415

REV.